


CALORIQUE



DICHTUNG - FÜR SELBSTREGULIERENDE INNENROHR-BEGLEITHEIZUNG 1/2" SEAL 1/2 " - FOR SELF-REGULATING INNER TUBE PIPE HEATING

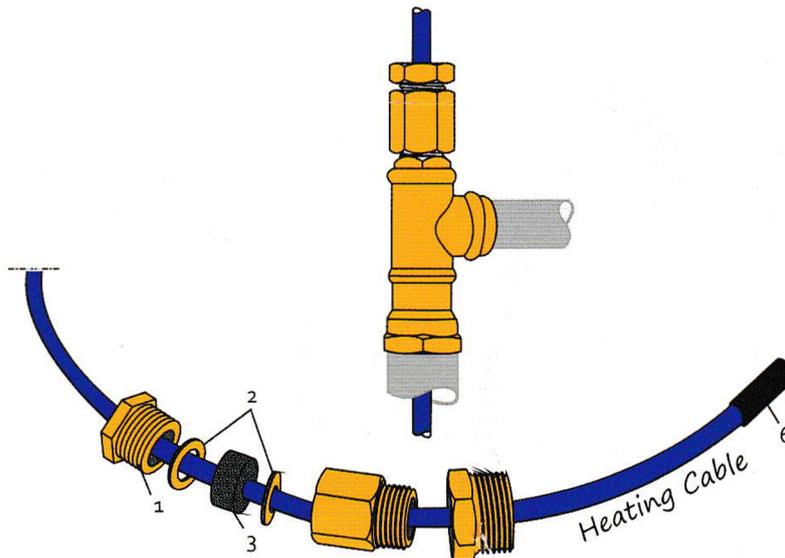

BEDIENUNGSANLEITUNG

1. Kabelverschraubung (23 mm Maulschlüssel)
 2. Dichtungsring auf beiden Seiten der Gummidichtung
 3. Dichtung
 4. Verschraubung mit R 1/2" Aussengewinde (23 mm Maulschlüssel)
 5. Zwischenstutzen mit R 3/4" oder R 1" Außengewinde (27 oder 36 mm Maulschlüssel)
 6. Endabschluss des Heizkabels, der nicht mit im Paket ist.
- Die Teile der Druckdurchführung gemäß der Abbildung auf das Heizkabel aufschieben.
Das Zwischenstutzen (5) ist vom Diameter des T-Stückes abhängig.



OPERATION INSTRUCTION

1. Barrel nut (23 mm set wrench)
 2. Support plates on both sides of the rubber gasket
 3. Gasket
 4. Seal seat with R 1/2" external thread (23 mm set wrench)
 5. Fit with R 3/4" or R 1" external thread (27 or 36 mm set wrench)
 6. The end shutting of the heating cable, which is not included in the package
- Thread the parts of the pressure lead-through in the order shown in the figure above.
The size of the fit (5) depends on the size of the T-connection.